



PLATE EXCHANGER

Polypropylene Counterflow HRV

CASING (Standard)

Material: 24-gauge galvanized steel

Drain connections: optional

Duct connections: 5" (127 mm)

Insulation: EPS molded polystyrene

Length: 23" (584.2 mm)

Height: 19" (482.6 mm)

Width: 16" (406.4 mm)

Weight: 45 lb (20 kg)

Exhaust Damper: Closed by gravity

Swivel ports for horizontal, vertical, oblique and mixed installations.



MOUNTING

Mounting chains included

Wall mounting optional (P/N 699921)



ELECTRICAL SPECIFICATIONS

120 V, 60 Hz, 181 W, 2.46 A



FILTERS

(Standard)

Quantity:

2 washable MERV 6 filters (P/N 70023)

Optional filter types: MERV 8 (P/N 70024),

MERV 13 (P/N 70025)

InspirAIR® ELITE

HRV

HK150-TF

161 CFM at 0.4 in.w.g



UNIT

CORE



BLOWERS & MOTORS

Two motorized impellers (backwards inclined)

Quick-connect motors for easy and efficient maintenance
PSC motor



DEFROST

Automatic timed integral exhaust defrost: cycles are controlled by a temperature sensor when the outdoor temperature drops below -5°C (23°F)

WARRANTY

Limited 5 years on the cores and all covered components

WALL CONTROLS

Low voltage dry contact (24VAC) for interlock with heating and cooling systems. For more details, please refer to the wall control specification sheets.



Digital Multifunction Control (P/N 611242-FC)



LCD Electronic Multifunction Control (P/N 611227)




20/40/60 Minute Timer (P/N 611228)



Speed Control (Low/Intermittent/High)
(P/N 611229)




Mode Control (Recirculation) (P/N 611230)

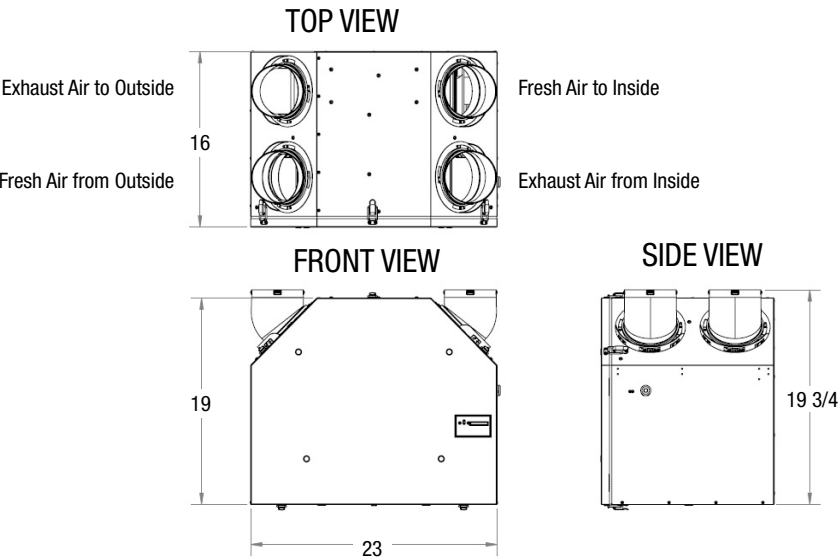

HK150-TF: PERFORMANCE

HK150-TF Ventilation Performance

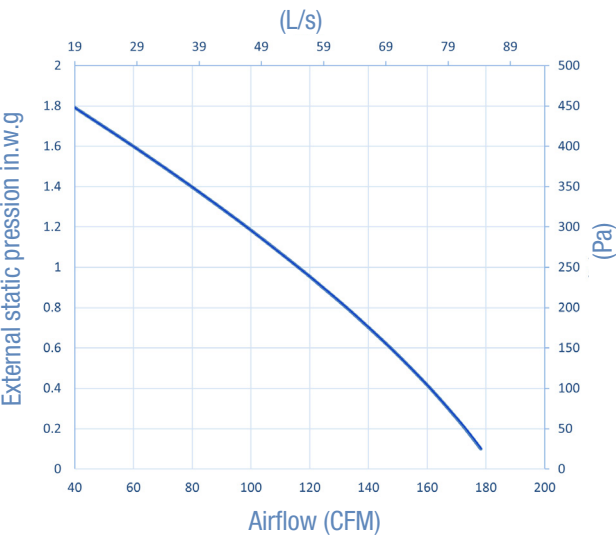

Thermal Performance – HK150-TF								
Supply Tem- perature		Net Airflow		Power Consumed (w)	Sensible Recovery Efficiency	Adjusted Sensible Recovery Efficiency	Latent Recovery/ Moisture Transfer	Total Recovery Efficiency
°F	°C	CFM	L/s					
Heating								
32	0	37	17	64	83%	96%	3%	-
32	0	51	24	77	83%	94%	2%	-
32	0	65	31	88	82%	92%	2%	-
32	0	80	38	97	81%	90%	7%	-

Project:		Architect:	
Location:		Engineer:	
Model #:		Contractor:	
Quantity:		Comments:	
Submitted By:			
Date:			